

PLEASE COMPLETE FORMS INDICATED & RETURN TO OUR OFFICE...THANK YOU!

WATER SERVICE APPLICATION

LEAD-FREE CERTIFICATION

MAIL TO: PENNSYLVANIA AMERICAN WATER
300 GALLEY ROAD
MCMURRAY, PA 15317

FAX# (724) 743 - 3124

CUSTOMER SERVICE CALL CENTER PHONE (1-800-565-7292)

Office Use Only Premise # _____
NSI Account # _____

WATER SERVICE APPLICATION

Please complete Property, Applicant and Signatures boxes below to apply for water service. Thank you for the opportunity to be YOUR water utility.

PROPERTY TO BE SERVED	HOUSE #	STREET PREFIX	STREET NAME & SUFFIX		
	MUNICIPALITY (CENT) Center Township	APT/LOT #	CITY	STATE	ZIP CODE
	SEWAGE AUTHORITY	TYPE OF SERVICE: <input type="checkbox"/> Residential <input type="checkbox"/> Commercial <input type="checkbox"/> Industrial <input type="checkbox"/> Other _____			
		TYPE OF HEAT: <input type="checkbox"/> Hot Water <input type="checkbox"/> Forced Air <input type="checkbox"/> Other _____			
APPLICANT(S) INFORMATION	NAME (First, Middle, Last)		SOCIAL SECURITY #	TELEPHONE #	
	NAME (First, Middle, Last)		SOCIAL SECURITY #	TELEPHONE #	
	MAILING ADDRESS (if different than service address)				

(I) (We), the Applicant(s) for water service from Pennsylvania American Water have read and understood the above application. (I) (We) will be jointly and severally bound by this Application to:

1. Pay a one-time fee of \$30.00 to cover the costs of setting up (MY) (OUR) account which will be added to your first bill.

READ ABOVE STATEMENTS BEFORE SIGNING

SIGNATURES	APPLICANT FOR SERVICE	APPLICANT FOR SERVICE
	DATE	DATE

FOR OFFICE USE ONLY

PWS: 5100012

USAGE DATA	WORK ZONE 330A	AW AREA 2411	DISTRICT CODE 330	CREW 24330	WORK ORDER
SERVICE TAP DATE	TAP SIZE	SERVICE SIZE	SERVICE TYPE		
METER ROUTE 1917	METER STOP	METER NUMBER	METER SIZE	# DIALS	
METER SET DATE	METER SET READING	METER LOCATION			
METER READ INSTRUCTIONS					
ADDITIONAL NOTES			"CENTER TOWNSHIP WATER PROJECT" Butler County		
Rate Code _____	Sewage Code _____	Distribution Zone _____	Engineering Area _____		

Copy To: { } Dispatch { } Call Center { } KAR { } { } { } WO File { } Other Butler

Account Number: _____

Premise / Service Number: _____

LEAD-FREE CERTIFICATION

I, _____, hereby request water service at the property located at


_____. I understand that under the Safe Drinking Water Act amendments of 1986, dwellings constructed after June 19, 1988, must use lead-free solder and/or lead-free materials in new household plumbing and for plumbing repairs. Under the regulations, solders and flux are "lead-free" when they contain not more than 0.2 percent lead. Pipes and pipe fittings are considered "lead-free" when they contain not more than 8.0 percent of lead.

I hereby certify that lead-free solder and other lead-free materials have been used in the construction of the plumbing at the aforesaid household.

DATE: _____

FORM P-37


Pennsylvania American Water Company – Western Division Standard Inside Meter Setting Requirements

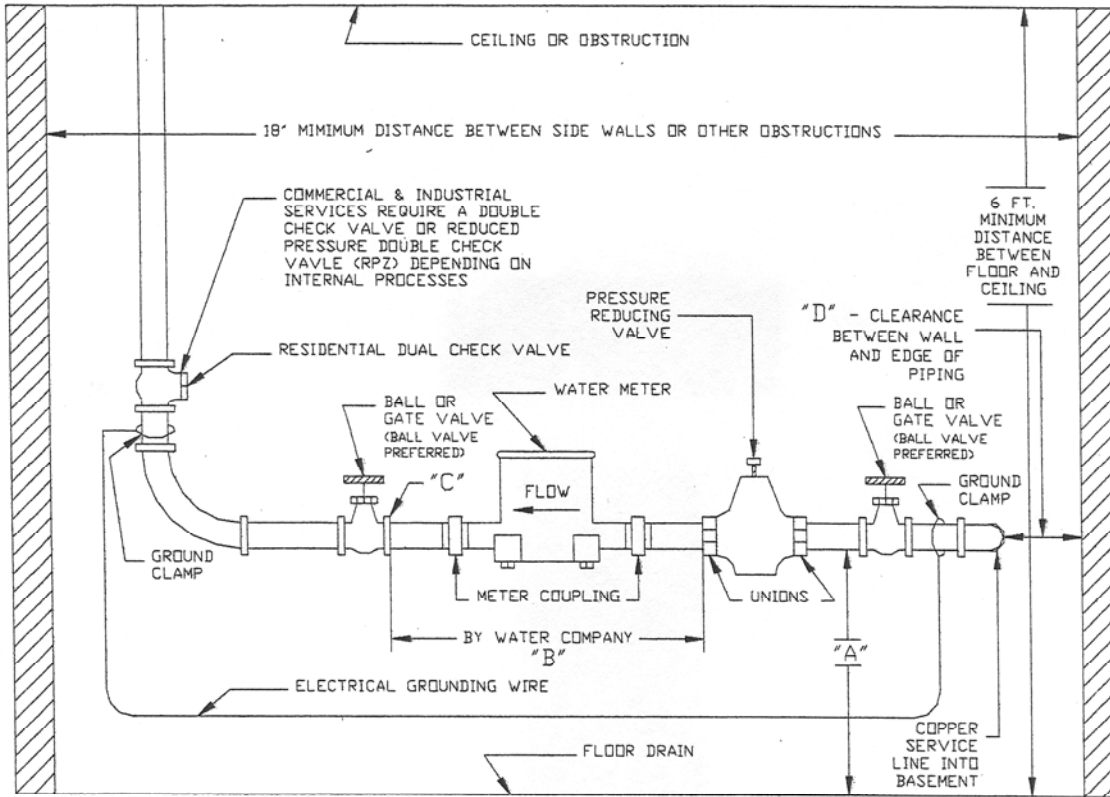

DIMENSIONS	"A"		"B"	"C"	"D"
METER SIZE	MINIMUM	MAXIMUM	ACTUAL	PIPE THREAD	MINIMUM
5/8"	18"	36"	12"	1/2"	3"
5/8" X 3/4"	18"	36"	12"	3/4"	3"
3/4"	18"	36"	14"	3/4"	4"
1"	18"	36"	15 1/2"	1"	5"

1. An inside meter will only be installed at properties where the distance from the municipal right-of-way to the building is less than 150 ft. and where the service line enters through the basement wall. If the distance is greater or the service line comes up through the basement floor slab, an outside meter pit is required. Refer to the "Standard 3/4" and 1" Service Line Installation With Outside Meter Pit" sheet if an outside meter pit is required.
2. Meter is not to be installed in the same area with electrical entrance service panel.
3. Meter must be located where service line enters premise.
4. The space occupied by the meter shall be made electrically continuous between inlet and outlet of meter by the use of a grounding wire and ground clamps conforming with the national electric code.
5. No stored materials or other obstructions are to be placed in the path of access to the meter.
6. The meter shall not be installed under steps or in crawl space.
7. A Pressure Reducing Valve (PRV) is required when pressure exceeds 100 PSI. (Unions are required on the PRV).
8. All other sources of water such as wells, cisterns, etc., must be physically disconnected from the piping that is to be serviced by the Water Company.
9. The customer shall drill a 1/4" hole through the exterior wall above ground to the outside where indicated by the Water Company in order for the Water Company to run wire from the inside meter to the outside read device.
10. The customer will be required to run the wire to the outside read device when finished game rooms, ceilings or other partitioned areas are involved.
11. The Water Company will install the meter after the customer has completed the above requirements and after the customer and Water Company complete their service lines.
12. A pressure expansion tank on the hot water system is highly recommended. The Water Company will not be responsible for any leakage from the hot water tank pop-off valve.

Pennsylvania-American Water Company
Standard 3/4" and 1" Service Line Installation With Inside Meter

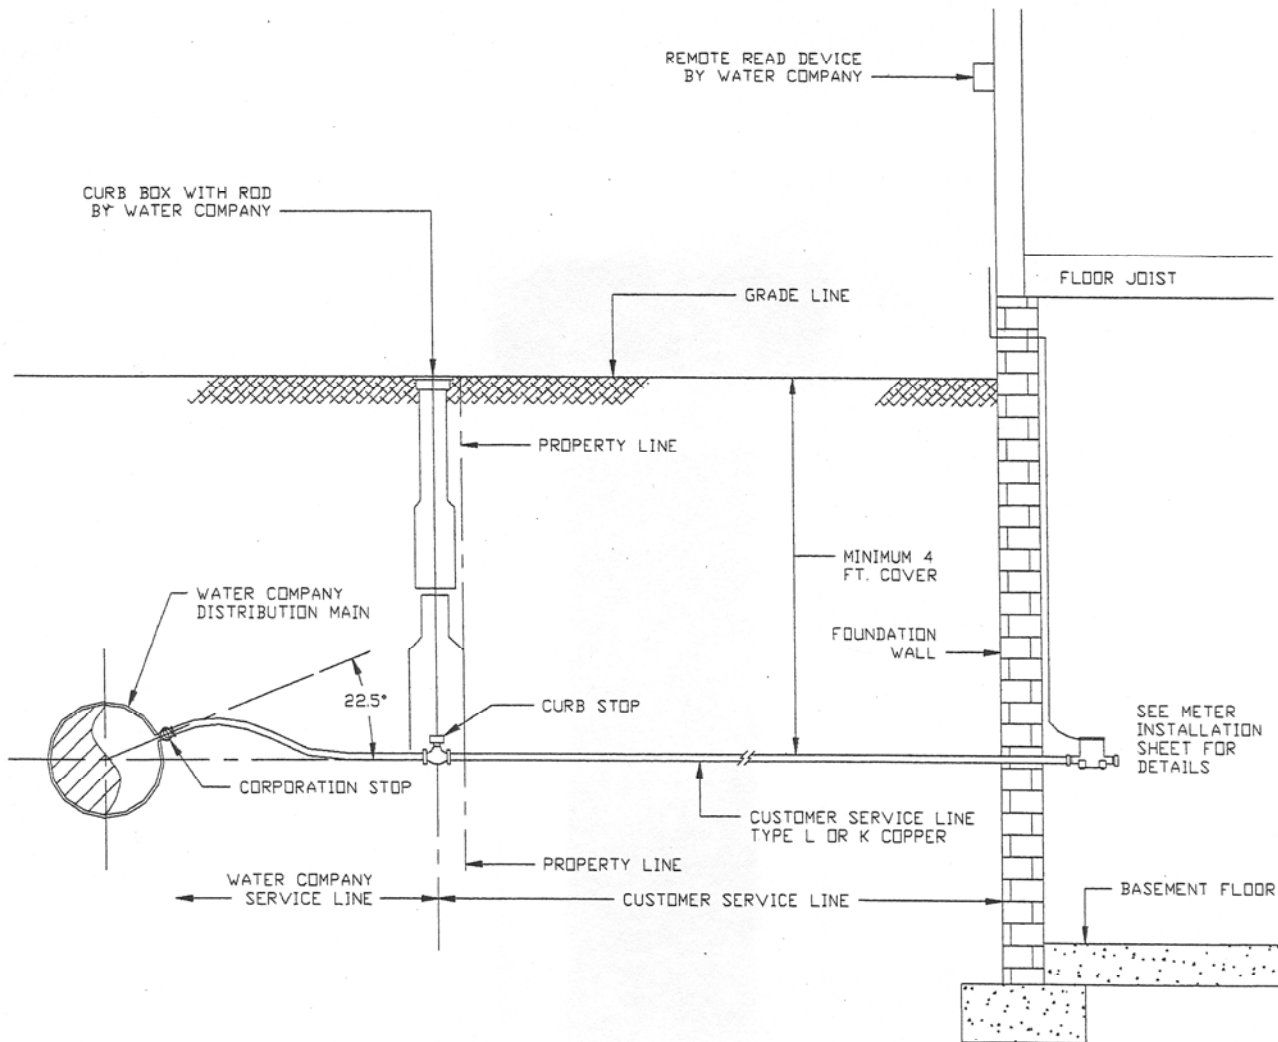

1. An inside meter will only be installed at properties where the distance from the municipal right-of-way to the building is less than 150 ft. and where the service line enters through the basement wall. If the distance is greater or the service line comes up through the basement floor slab, an outside meter pit is required. Refer to the "Standard 3/4" and 1" Service Line Installation With Outside Meter Pit" sheet if an outside meter pit is required.
2. The Water Company will locate the water main and mark the location where your service line should end. You are responsible for installing and maintaining all service materials after the curb stop except for the meter & meter couplings. Leave three feet of copper extended out of the ground where your service line ends.
3. The Water Company will install its service connection and connect your service after your service line is installed. Please notify the Water Company at least two weeks prior to the date that you will require water service.
4. Your service line must be 3/4" or 1" type L or K copper and installed as detailed in the sketch above. Flared or compression couplings must be used for all underground connections.
5. Your service line cannot be installed in the same trench with any other public utility or within three feet of any excavation or vault.
6. A separate service line is required for each metered connection.
7. Service cannot be provided if the foregoing requirements are not met.

